

# PLAN SHOWING EXTENSION TO GOODWILL BOTTLING LTD. BUILDING


Scale: 1 inch = 20 feet

- Requirements - Fire Chief Office  
29-5-67. It is agreed Mr Goodwill will remove
1. Compressed gas installation from site;
  2. Gasoline & Diesel fluids will be dispensed from other than roadway location, in relation to position of vehicle.
  3. Vents & fill pipes to be located outside of building to approval of officer.
  4. Storage tanks location is to be in accordance with F.M. Letter Apr. 18-67.
  5. Dispensing pumps & meters to be located outside of building.
  6. All electrical work & material to meet Electrical Inspector's Approval.

**APPROVED, SUBJECT TO  
REGULATIONS MADE PURSUANT  
TO THE FIRE MARSHAL ACT.**

VICTORIA FIRE DEPARTMENT

*[Signature]* Deputy 29/5/67  
Subject to above requirements -  
*[Signature]* Edward Goodwill

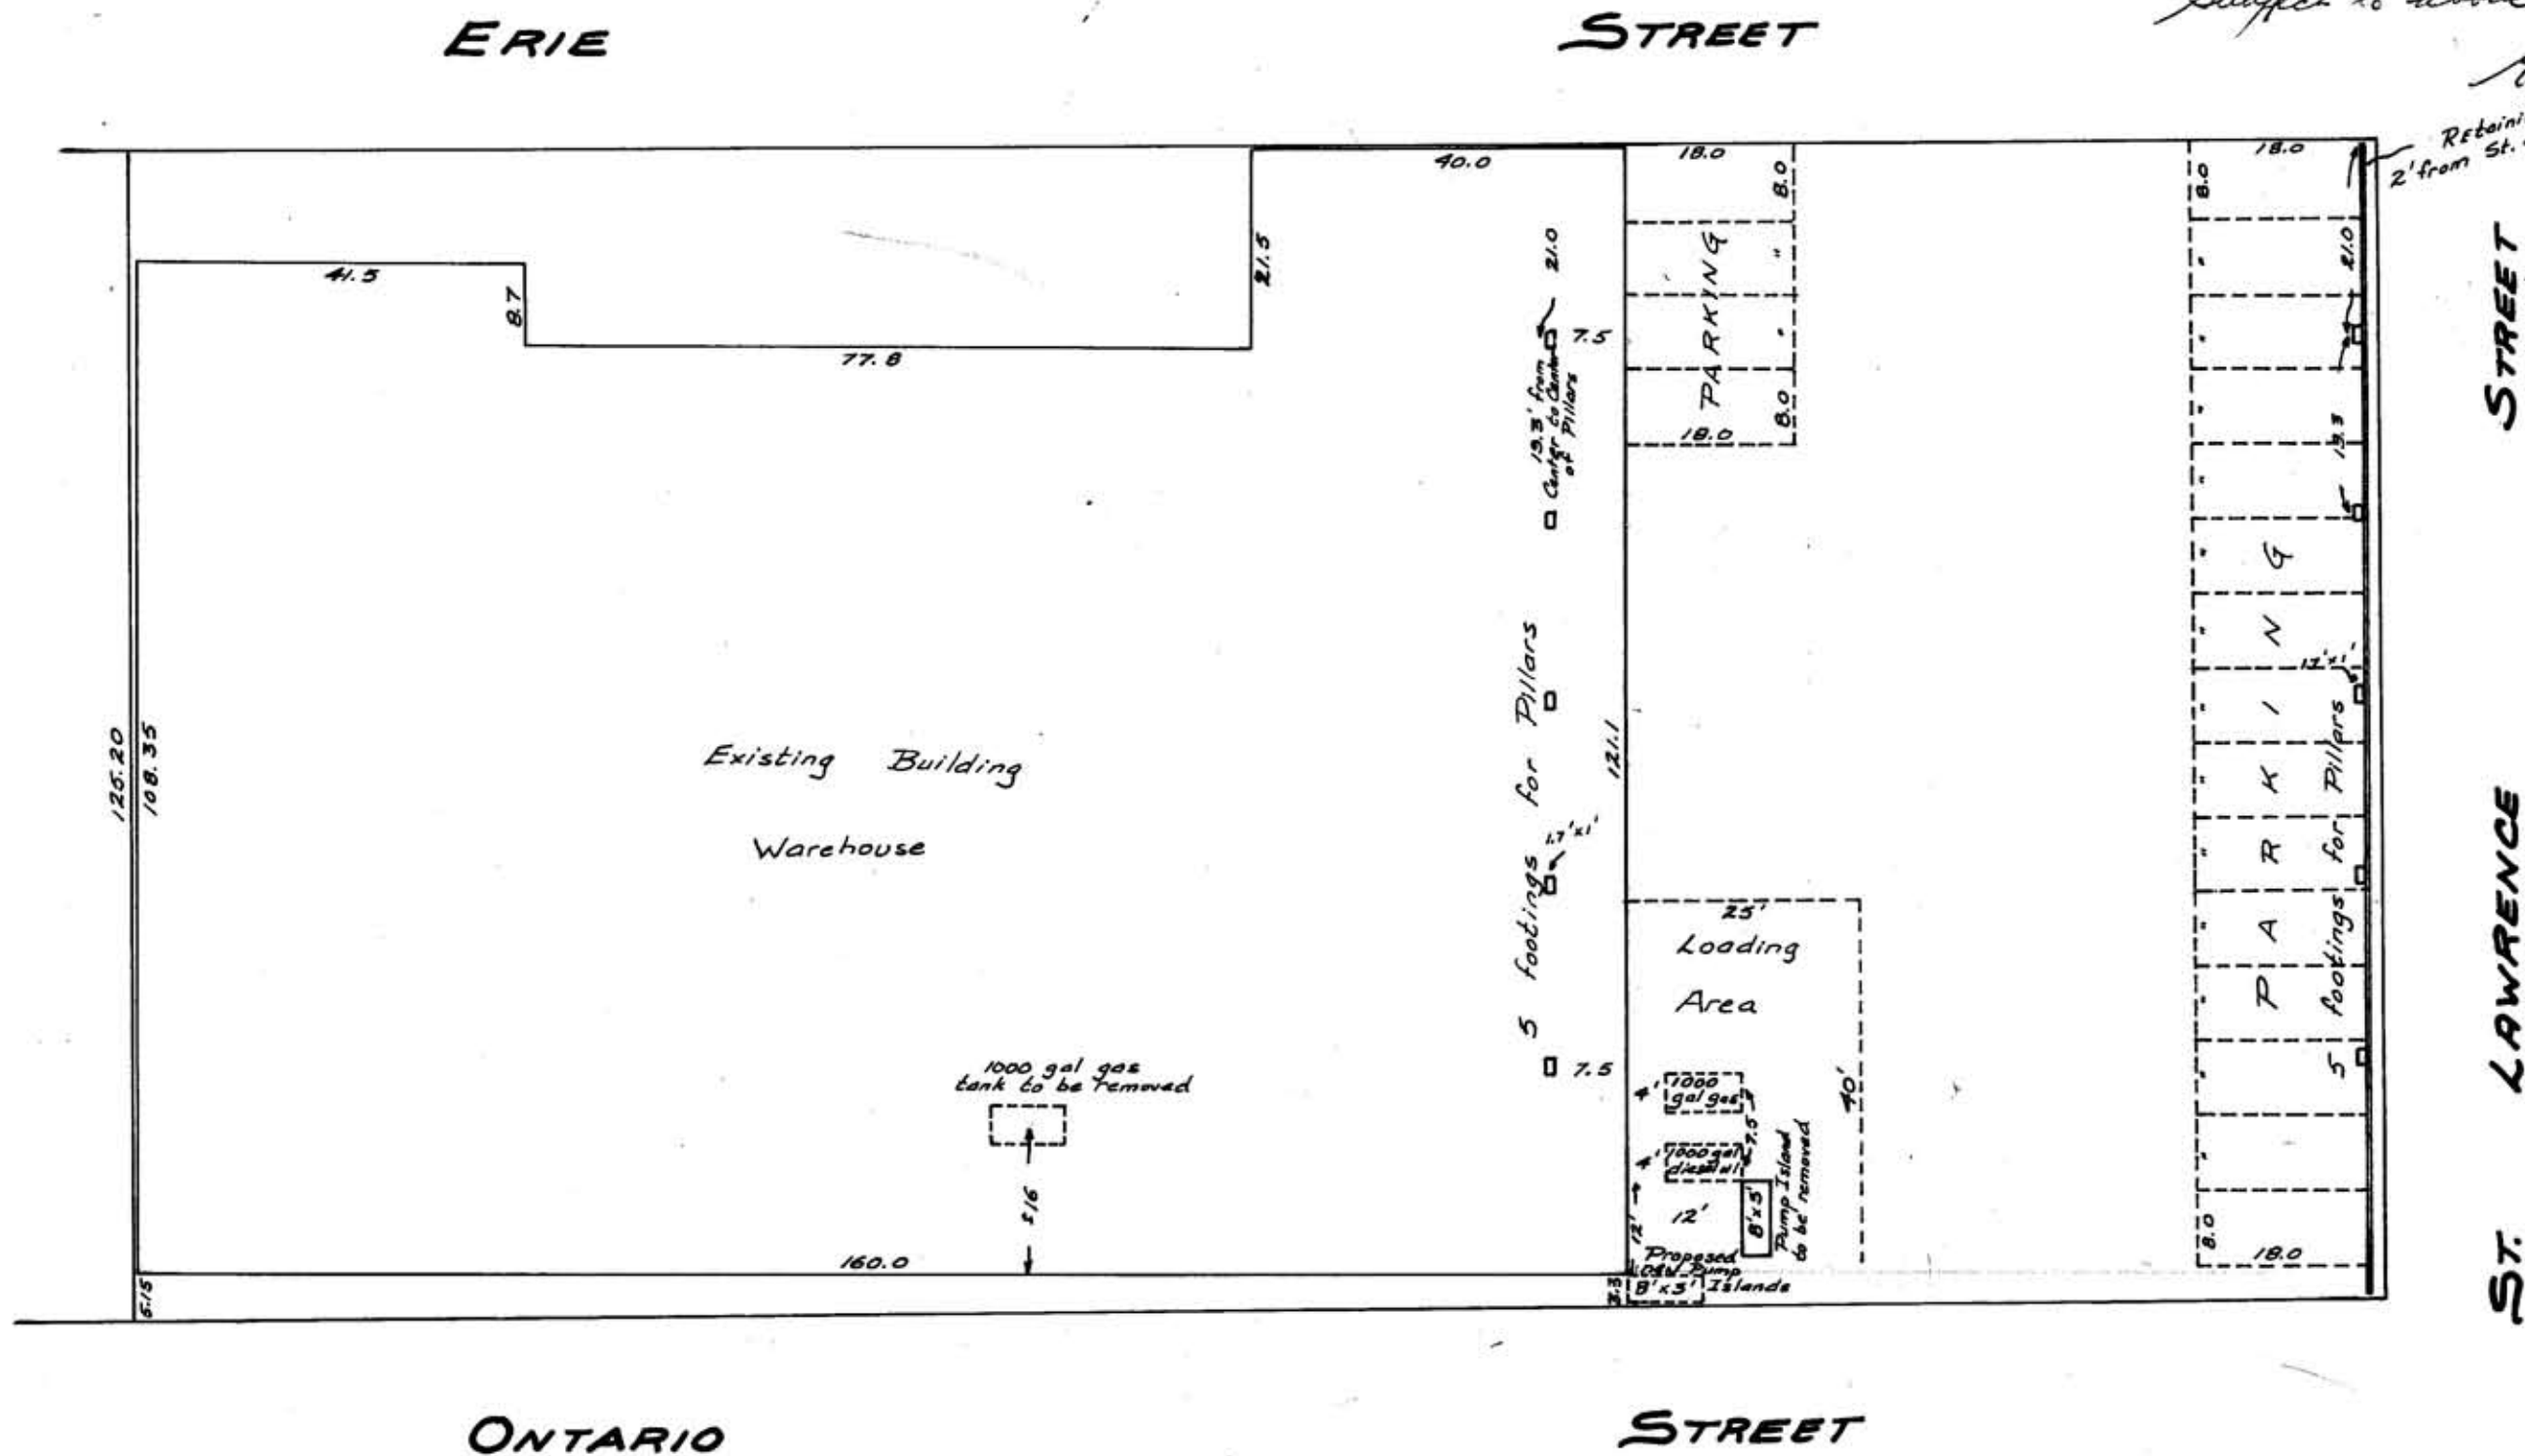

April 18th, 1967.

Mr. Edward Gudewill,  
Goodwill Bottling Ltd.,  
35 Erie Street,  
VICTORIA, B. C.

Dear Sir:-

RE: DIESEL AND GASOLINE STORAGE TANKS AT  
GOODWILL BOTTLING, LTD., VICTORIA, B. C.

This will confirm your recent discussion with  
Deputy Fire Marshal Collier concerning the above-noted subject.

Your proposal to construct a building over the  
present tank location will be acceptable subject to the following  
conditions:

1. Dispensing pumps and meters shall be located outside the  
building.
2. Vent and fill pipes shall terminate outside the building.
3. No building supports or foundations shall be located within  
three feet of storage tanks.
4. Necessary alterations to existing facility shall be done  
subject to permit from local authority who is Fire Chief  
Simmons, Victoria, B. C.

Yours truly,

BASIL NIXON,  
FIRE MARSHAL.

per

H. K. JENNS,  
DEPUTY FIRE MARSHAL.

KHC:bw

CC Fire Chief Simmons

copy  
sent  
P.H.C.F.  
G.N.S.